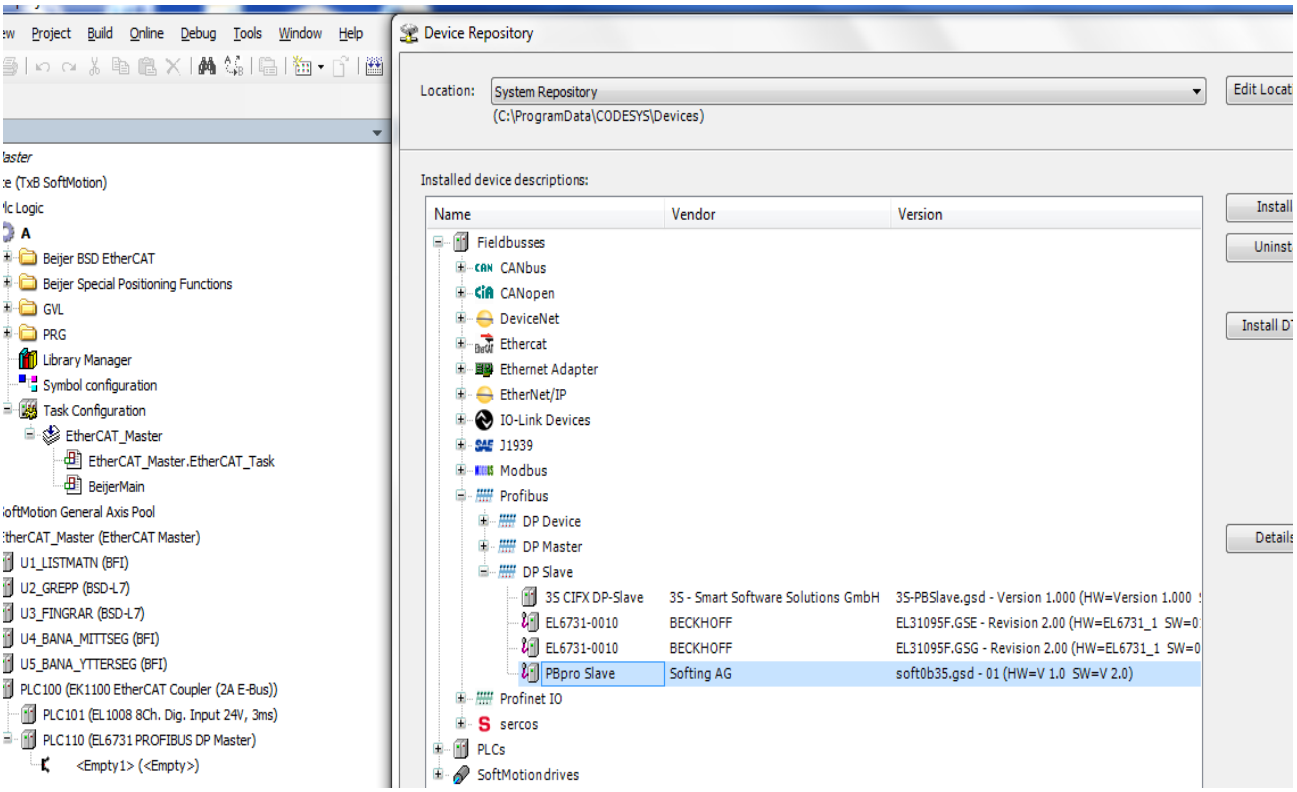
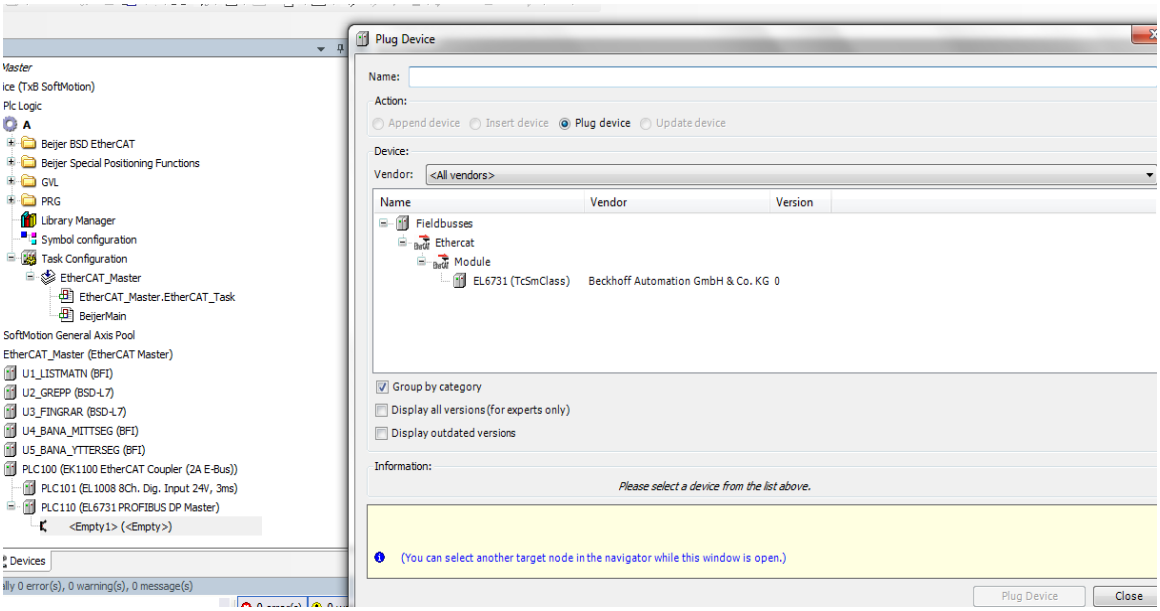

Project Build Online Debug Tools Window Help
Device Repository
Location: System Repository
(C:\ProgramData\CODESYS\Devices)
Edit Locat
Installed device descriptions:
Name Vendor Version
Install
Uninst
Install D
Details
Beijer BSD EtherCAT
Beijer Special Positioning Functions
GVL
PRG
Library Manager
Symbol configuration
Task Configuration
EtherCAT_Master
EtherCAT_Master.EtherCAT_Task
BeijerMain
EtherCAT_Master (EtherCAT Master)
U1_LISTMATN (BFI)
U2_GREPP (BSD-L7)
U3_FINGRAR (BSD-L7)
U4_BANA_MITTSEG (BFI)
U5_BANA_YTTERSEG (BFI)
PLC100 (EK1100 EtherCAT Coupler (2A E-Bus))
PLC101 (EL1008 8Ch. Dig. Input 24V, 3ms)
PLC110 (EL6731 PROFIBUS DP Master)
<Empty1> (<Empty>)
Fieldbusses
CANbus
CANopen
DeviceNet
Ethercat
Ethernet Adapter
EtherNet/IP
IO-Link Devices
J1939
Modbus
Profibus
DP Device
DP Master
DP Slave
3S CIFX DP-Slave
3S - Smart Software Solutions GmbH
3S-PBSlave.gsd - Version 1.000 (HW=Version 1.000
EL6731-0010
BECKHOFF
EL31095F.GSE - Revision 2.00 (HW=EL6731_1 SW=0
EL6731-0010
BECKHOFF
EL31095F.GSG - Revision 2.00 (HW=EL6731_1 SW=0
PBpro Slave
Softing AG
soft0b35.gsd - 01 (HW=V 1.0 SW=V 2.0)
Profinet IO
sercos
PLCs
SoftMotion drives


Plug Device
Name:
Action:
Append device
Insert device
Plug device
Update device
Device:
Vendor:
<All vendors>
Name Vendor Version
Fieldbusses
Ethercat
Module
EL6731 (TcSmClass)
Beckhoff Automation GmbH & Co. KG 0
Group by category
Display all versions (for experts only)
Display outdated versions
Information:
Please select a device from the list above.
(You can select another target node in the navigator while this window is open.)
Plug Device
Close
Devices
0 error(s), 0 warning(s), 0 message(s)