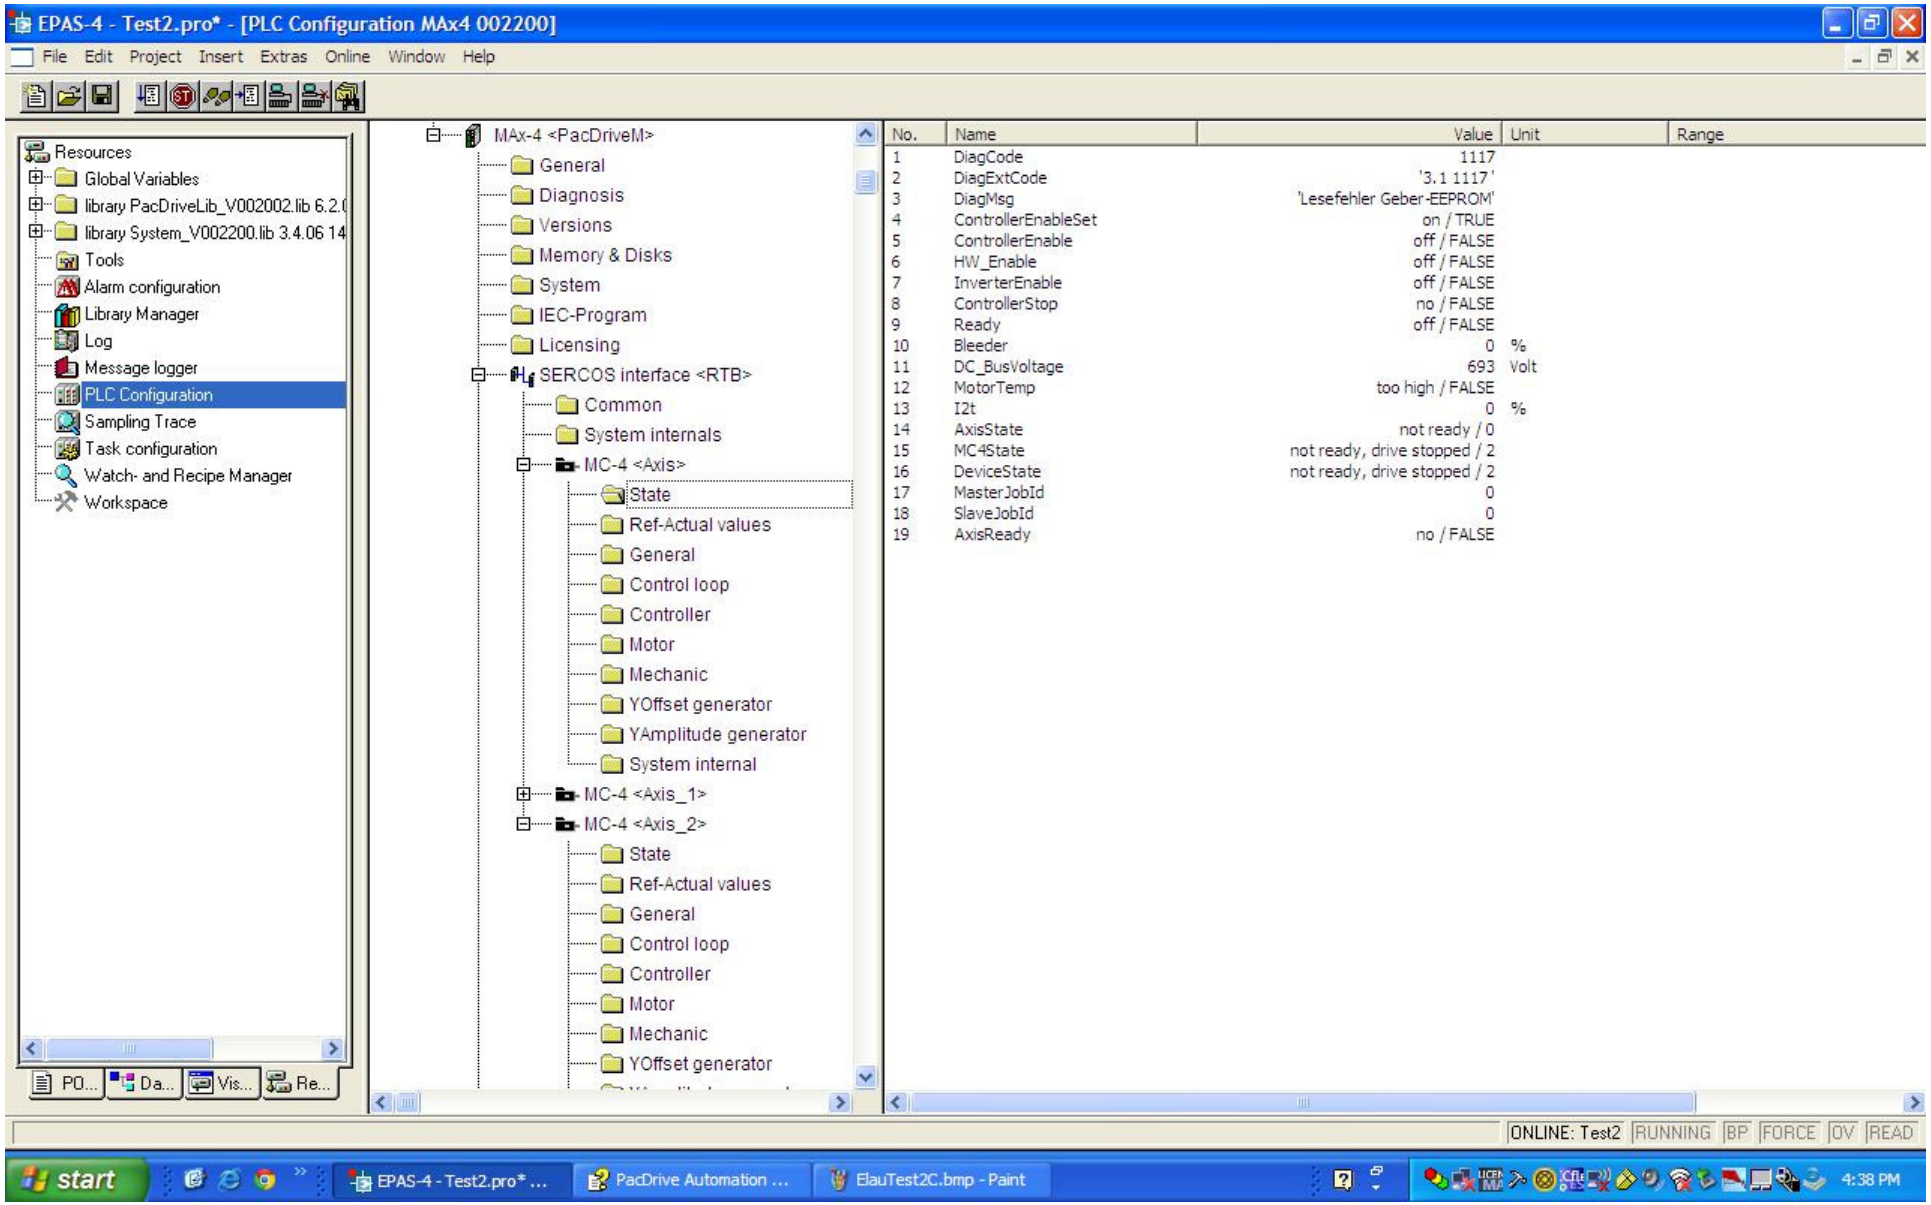

EPAS-4 - Test2.pro* - [PLC Configuration MAx4 002200]
File Edit Project Insert Extras Online Window Help
Resources
Global Variables
library PacDriveLib_V002002.lib 6.2.(
library System_V002200.lib 3.4.06 14
Tools
Alarm configuration
Library Manager
Log
Message logger
PLC Configuration
Sampling Trace
Task configuration
Watch- and Recipe Manager
Workspace
PO...
Da...
Vis...
Re...
MAx-4 <PacDriveM>
General
Diagnosis
Versions
Memory & Disks
System
IEC-Program
Licensing
SERCOS interface <RTB>
Common
System internals
MC-4 <Axis>
State
Ref-Actual values
General
Control loop
Controller
Motor
Mechanic
YOffset generator
YAmplitude generator
System internal
MC-4 <Axis_1>
MC-4 <Axis_2>
State
Ref-Actual values
General
Control loop
Controller
Motor
Mechanic
YOffset generator
No. Name Value Unit Range
1 DiagCode 1117
2 DiagExtCode '3.1 1117 '
3 DiagMsg 'Lesefehler Geber-EEPROM'
4 ControllerEnableSet on / TRUE
5 ControllerEnable off / FALSE
6 HW_Enable off / FALSE
7 InverterEnable off / FALSE
8 ControllerStop no / FALSE
9 Ready off / FALSE
10 Bleeder 0 %
11 DC_BusVoltage 693 Volt
12 MotorTemp too high / FALSE
13 I2t 0 %
14 AxisState not ready / 0
15 MC4State not ready, drive stopped / 2
16 DeviceState not ready, drive stopped / 2
17 MasterJobId 0
18 SlaveJobId 0
19 AxisReady no / FALSE
ONLINE: Test2 RUNNING BP FORCE OV READ
start
EPAS-4 - Test2.pro* ...
PacDrive Automation ...
ElauTest2C.bmp - Paint
4:38 PM