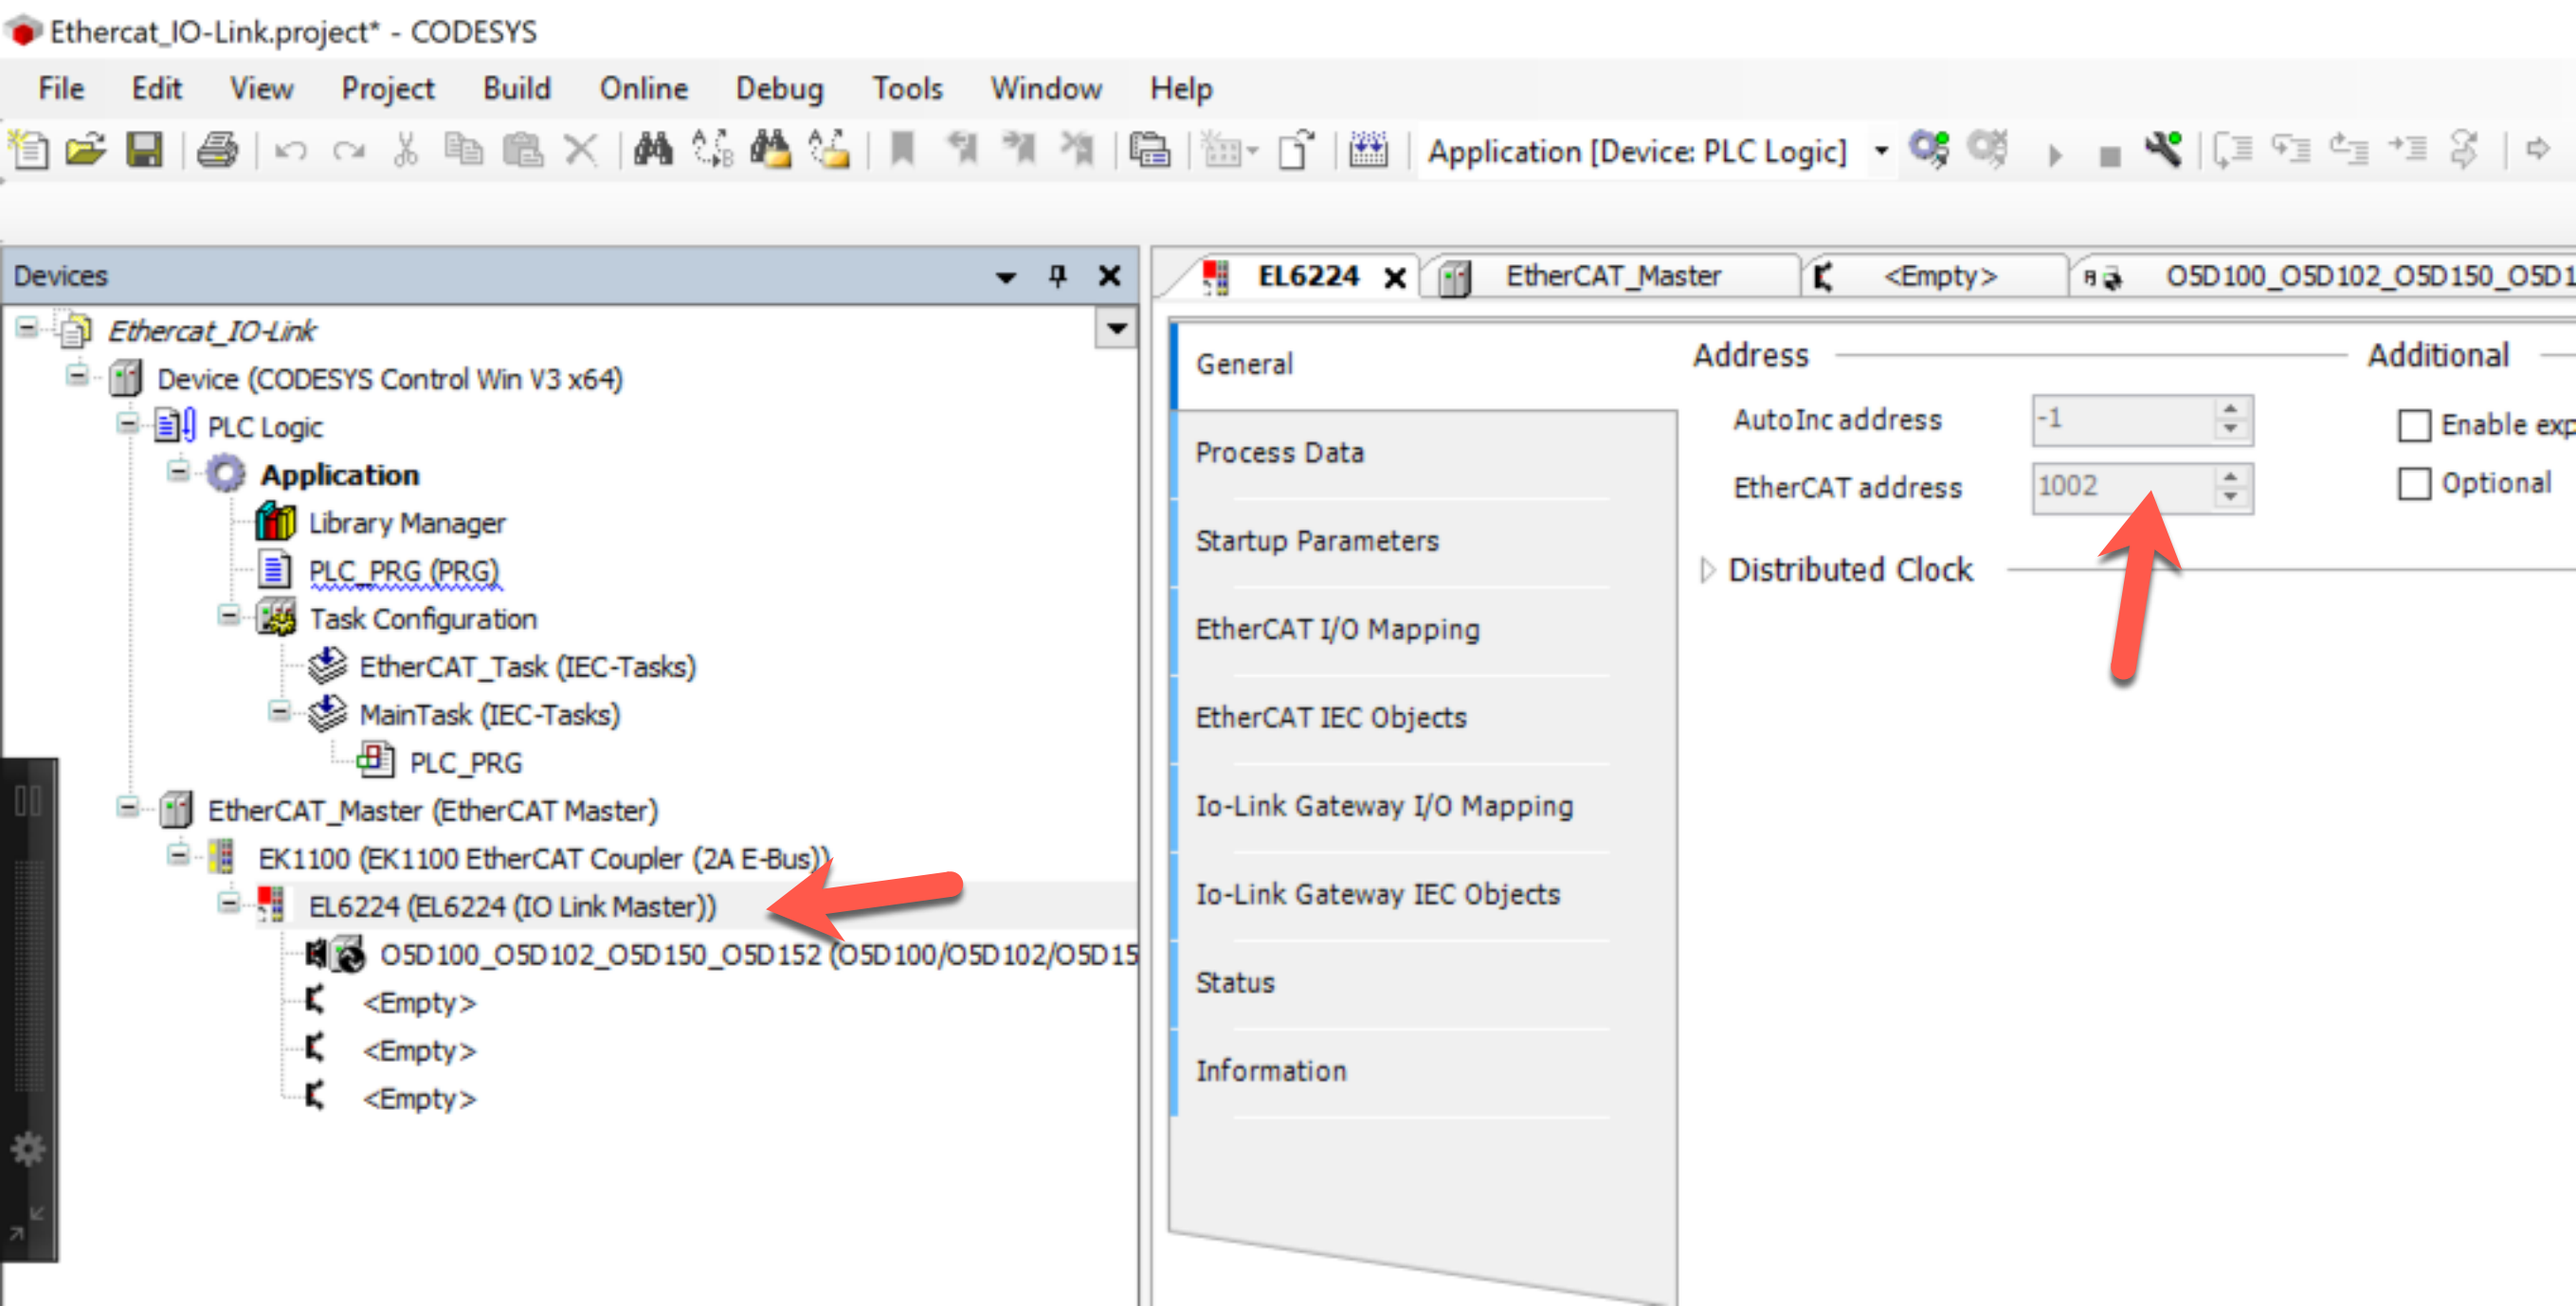

Ethercat_IO-Link.project* - CODESYS
File Edit View Project Build Online Debug Tools Window Help
Application [Device: PLC Logic]
Devices
Ethercat_IO-Link
Device (CODESYS Control Win V3 x64)
PLC Logic
Application
Library Manager
PLC_PRG (PRG)
Task Configuration
EtherCAT_Task (IEC-Tasks)
MainTask (IEC-Tasks)
PLC_PRG
EtherCAT_Master (EtherCAT Master)
EK1100 (EK1100 EtherCAT Coupler (2A E-Bus))
EL6224 (EL6224 (IO Link Master))
O5D100_O5D102_O5D150_O5D152 (O5D100/O5D102/O5D15
<Empty>
<Empty>
<Empty>
EL6224
EtherCAT_Master
<Empty>
O5D100_O5D102_O5D150_O5D1
General
Process Data
Startup Parameters
EtherCAT I/O Mapping
EtherCAT IEC Objects
Io-Link Gateway I/O Mapping
Io-Link Gateway IEC Objects
Status
Information
Address
AutoInc address
-1
EtherCAT address
1002
Distributed Clock
Additional
Enable exp
Optional